


EYE BOLT OR TOGGLE BOLT 14" OR 24".
CUSTOMER SHOULD EXTEND BOLT THROUGH
FACIA TO ROOF JOIST, RAFTER, OR SOLID
LUMBER AND FASTEN SECURELY. DO NOT USE
THREAD THRU INSULATOR OR SCREW TYPE HOOK.

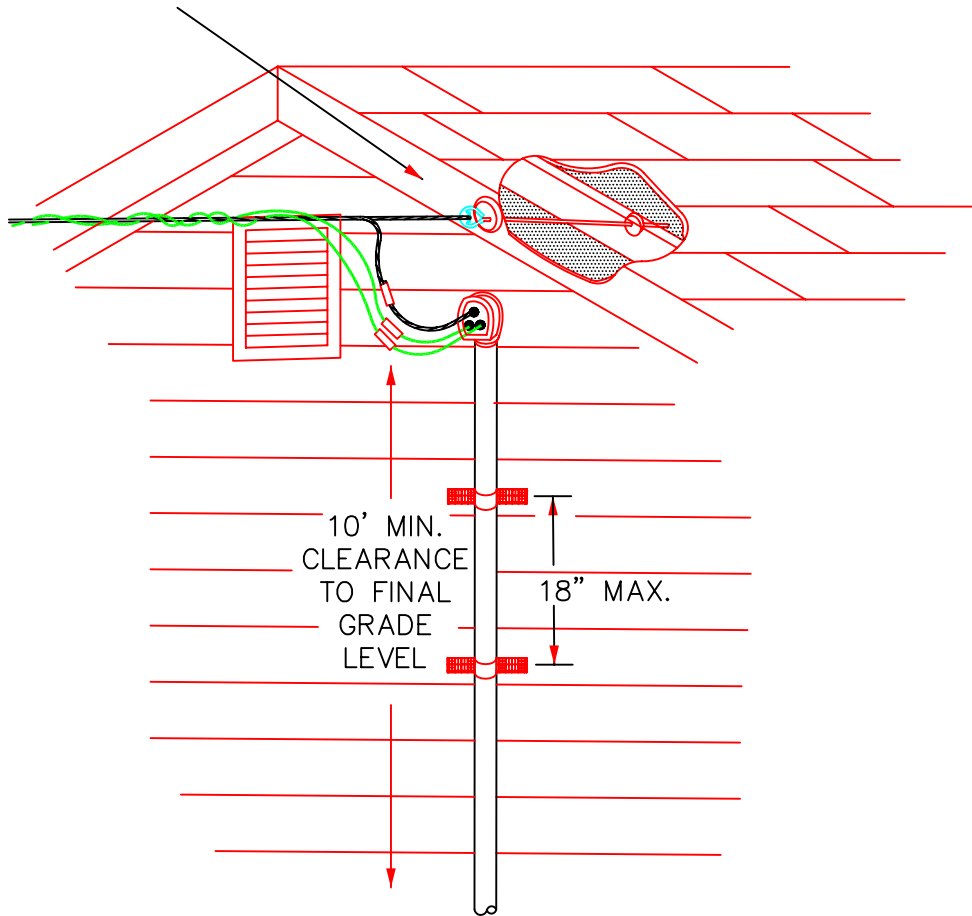

NOTES:

1. DEVICE FOR ATTACHING SERVICE DROP TO BUILDING FURNISHED AND INSTALLED SECURELY BY CUSTOMER AS NOTED ABOVE.
2. CONNECTIONS BETWEEN SERVICE ENTRANCE CONDUCTORS AND SERVICE DROP SHALL BE MADE BY NEWNAN UTILITIES BELOW WEATHER HEAD, FORMING A DRIP LOOP.

TRIPLEX SERVICE INSTALLATION