


* SERVICE DROP
 MINIMUM CLEARANCES
 12 FT. - ABOVE SIDEWALKS
 15 FT. - ABOVE RESIDENTIAL
 DRIVEWAYS
 18 FT. - ABOVE PUBLIC DRIVEWAYS
 AND ROADS.

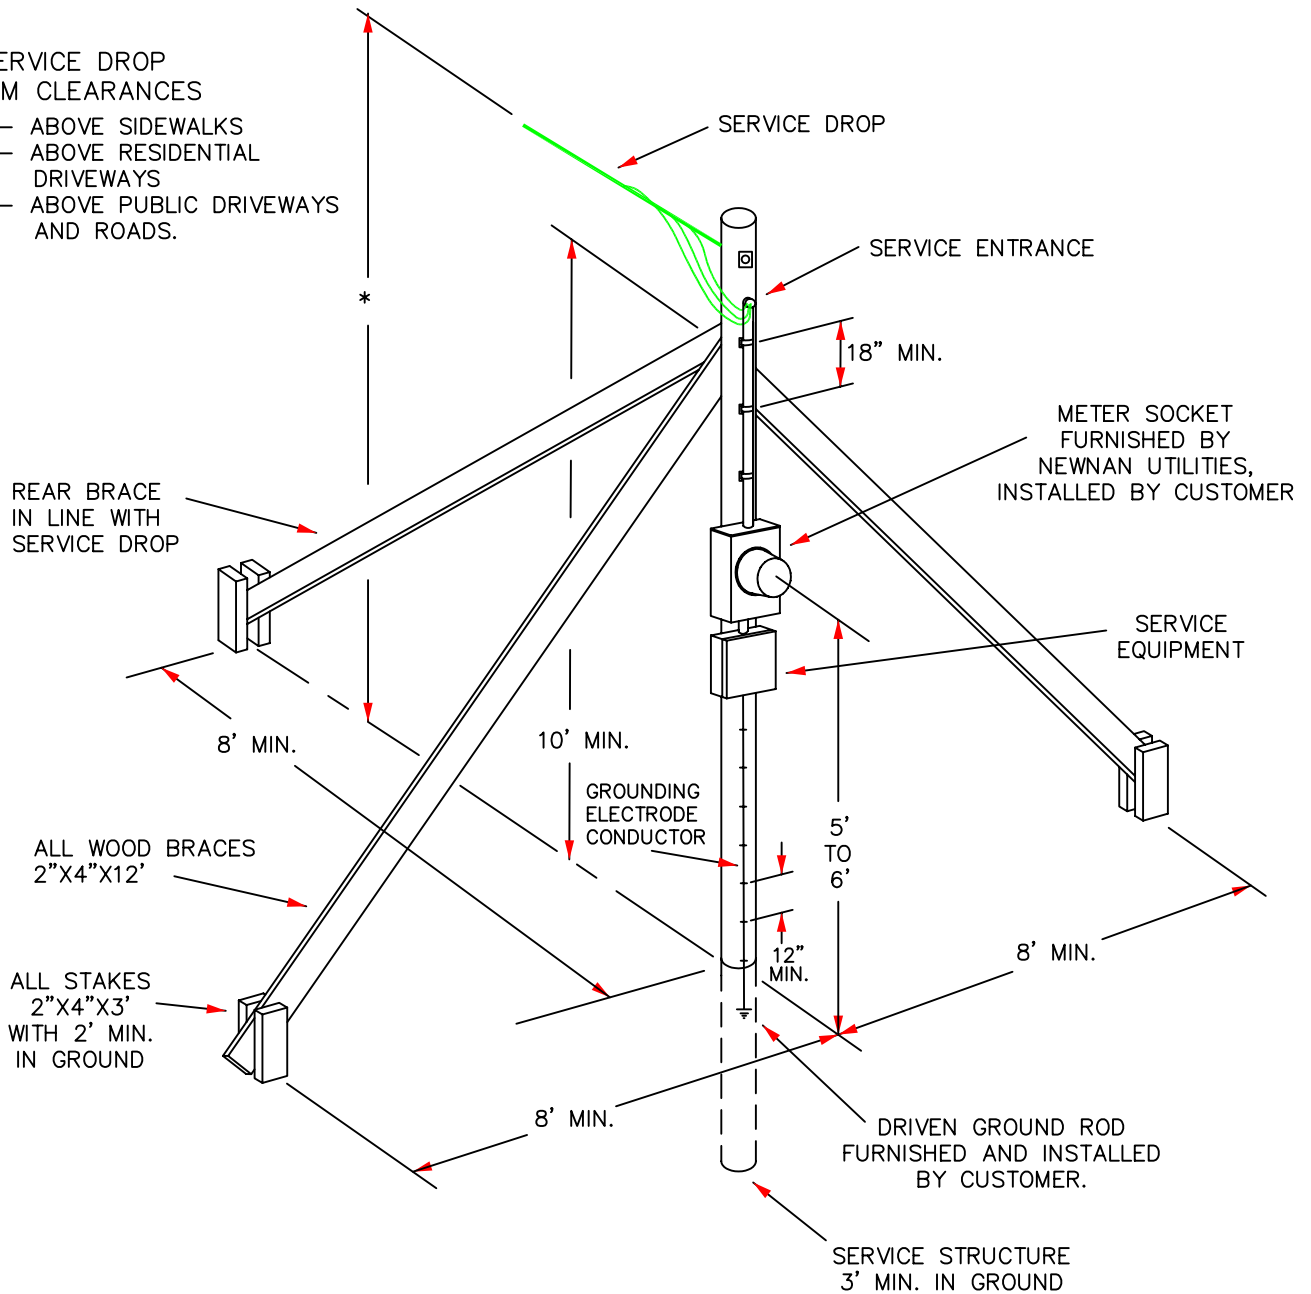

NEWNAN UTILITIES TO LOCATE TEMPORARY SERVICE LOCATION
 CUSTOMER SHALL FURNISH, INSTALL AND MAINTAIN:

- A. TREATED WOOD SERVICE STRUCTURE RATED FOR IN GROUND USE WITH BRACES AND STAKES TO BE SOUND.
- B. SERVICE ENTRANCE CABLE AND CONDUIT WHERE REQUIRED.
- C. SERVICE DISCONNECT.
- D. GROUND ROD WITH WITH NO.6 MINIMUM COPPER GROUNDING ELECTRODE CONDUCTOR.

TYPICAL STRUCTURE FOR TEMPORARY OVERHEAD SERVICE